

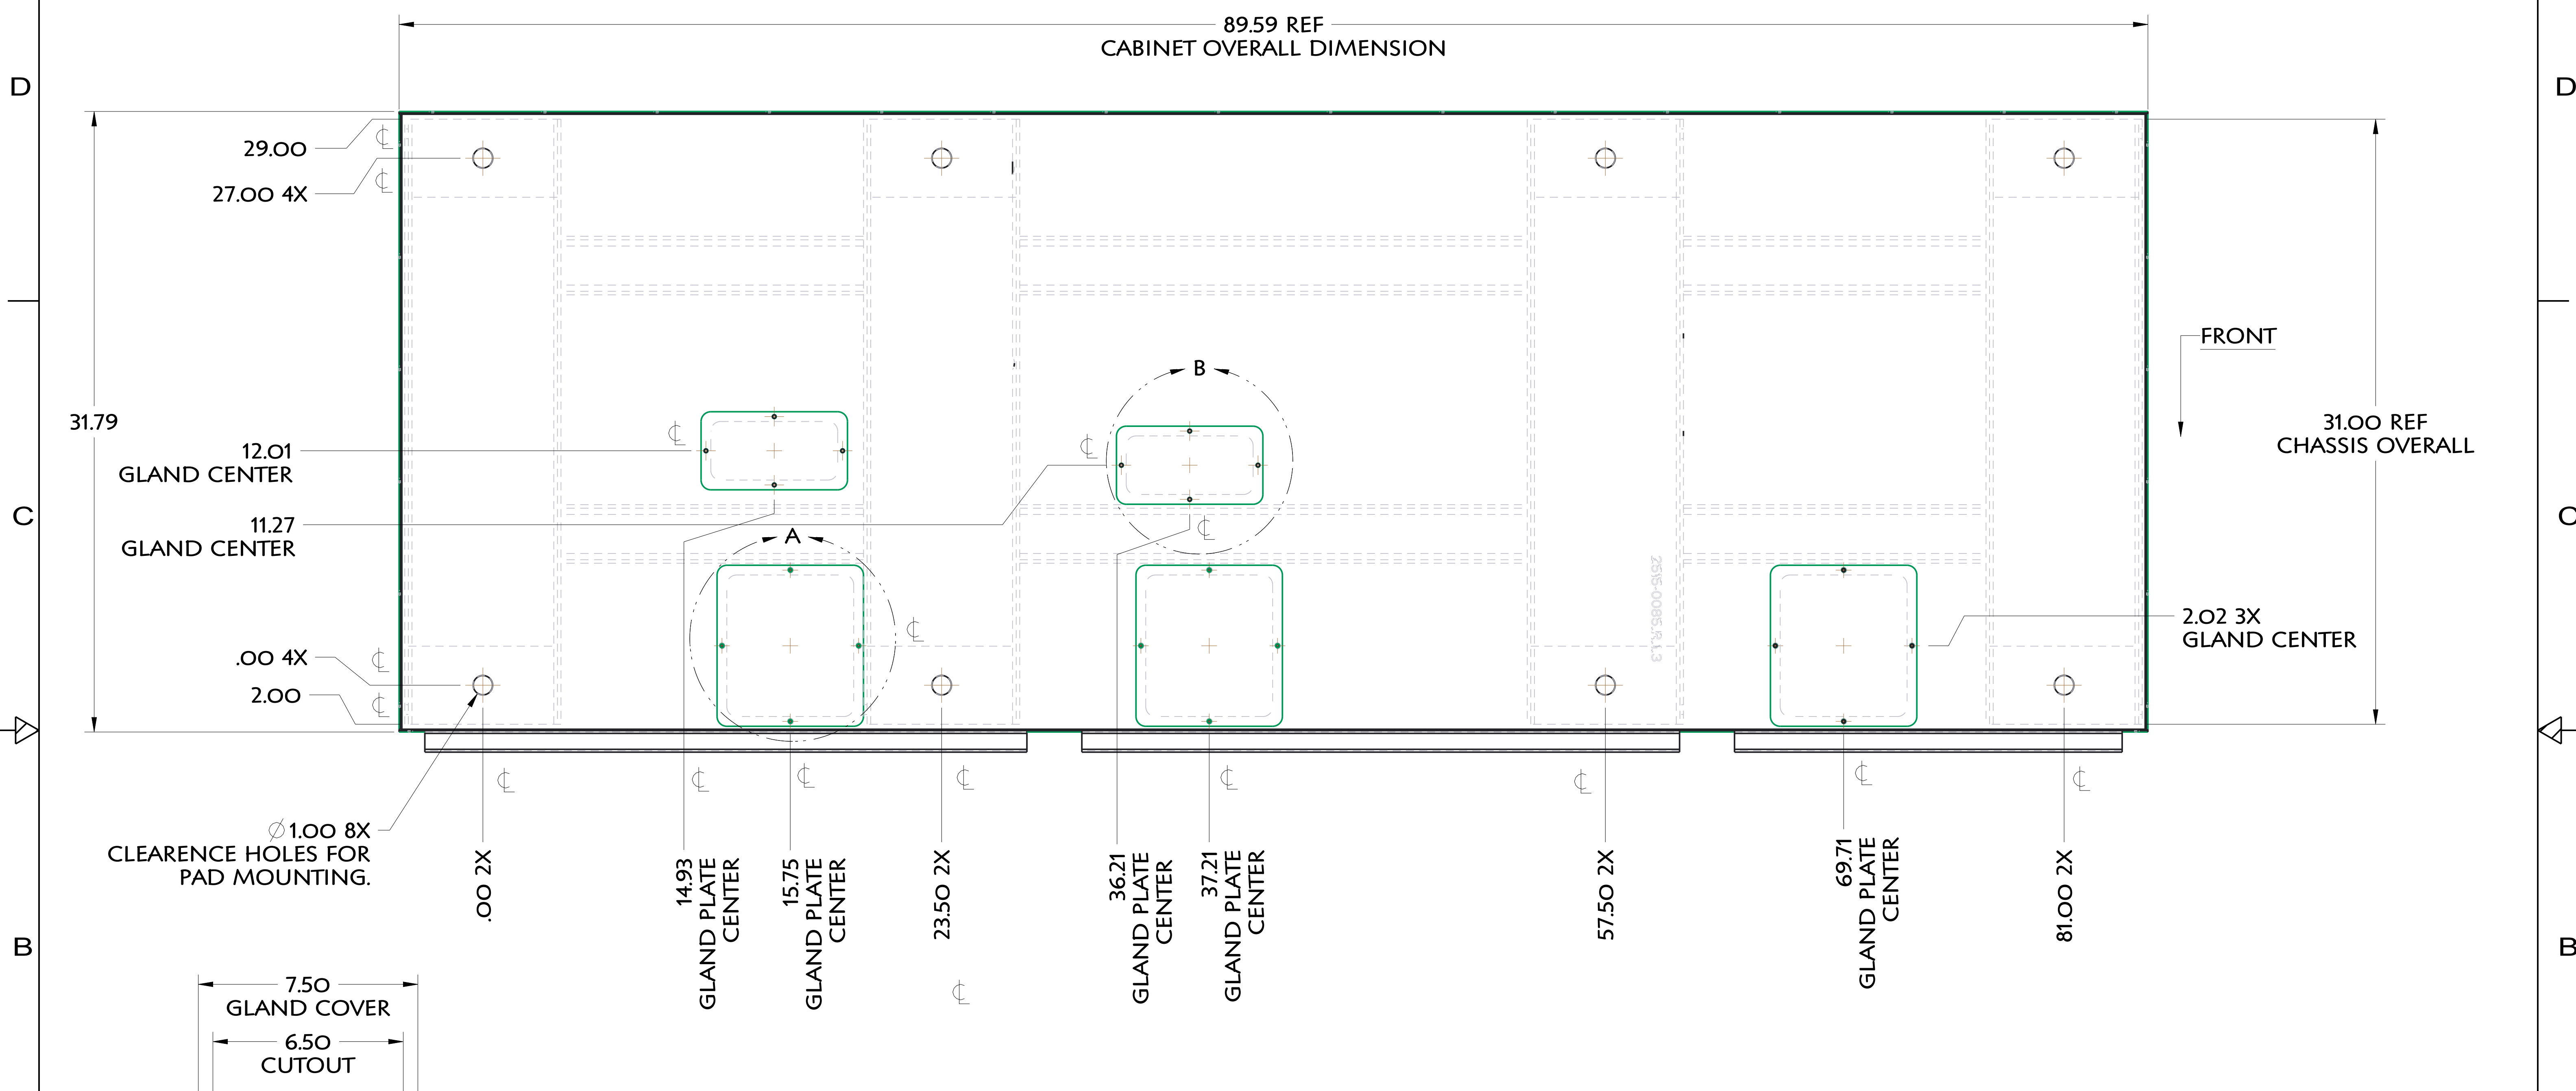


REVISION HISTORY				DATE	APPROVED
ZONE	REV	DESCRIPTION		6/19/14	PH
	1.0	RELEASE FOR REVIEW			

**OVERHEAD SECTION VIEW
PAD MOUNTING INSTALLATION DIAGRAM**

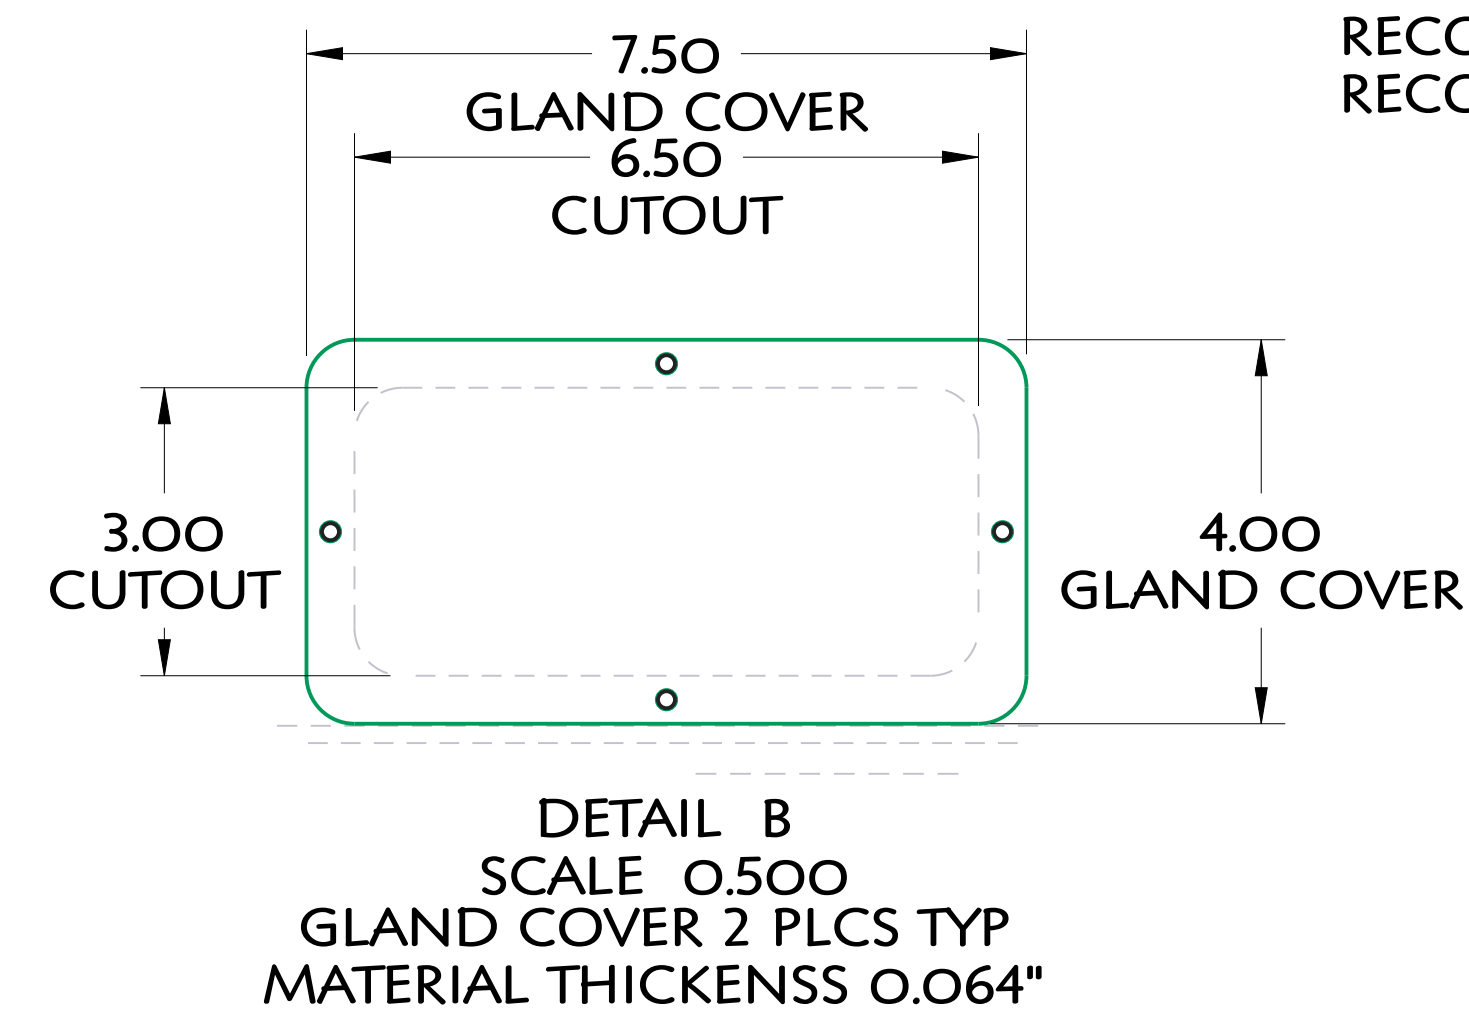

PAD MOUNT NOTES:
 RECOMMENDED PAD MOUNTING FOR USE WITH 1/2-13 J-BOLTS EMBEDMENT 6" MINIMUM IN CONCRETE PAD.
 RECOMMENDED LENGTH OF EXPOSED THREAD 1-1/2" LONG PAST PAD. FLAT AND LOCK WASHERS RECOMMENDED

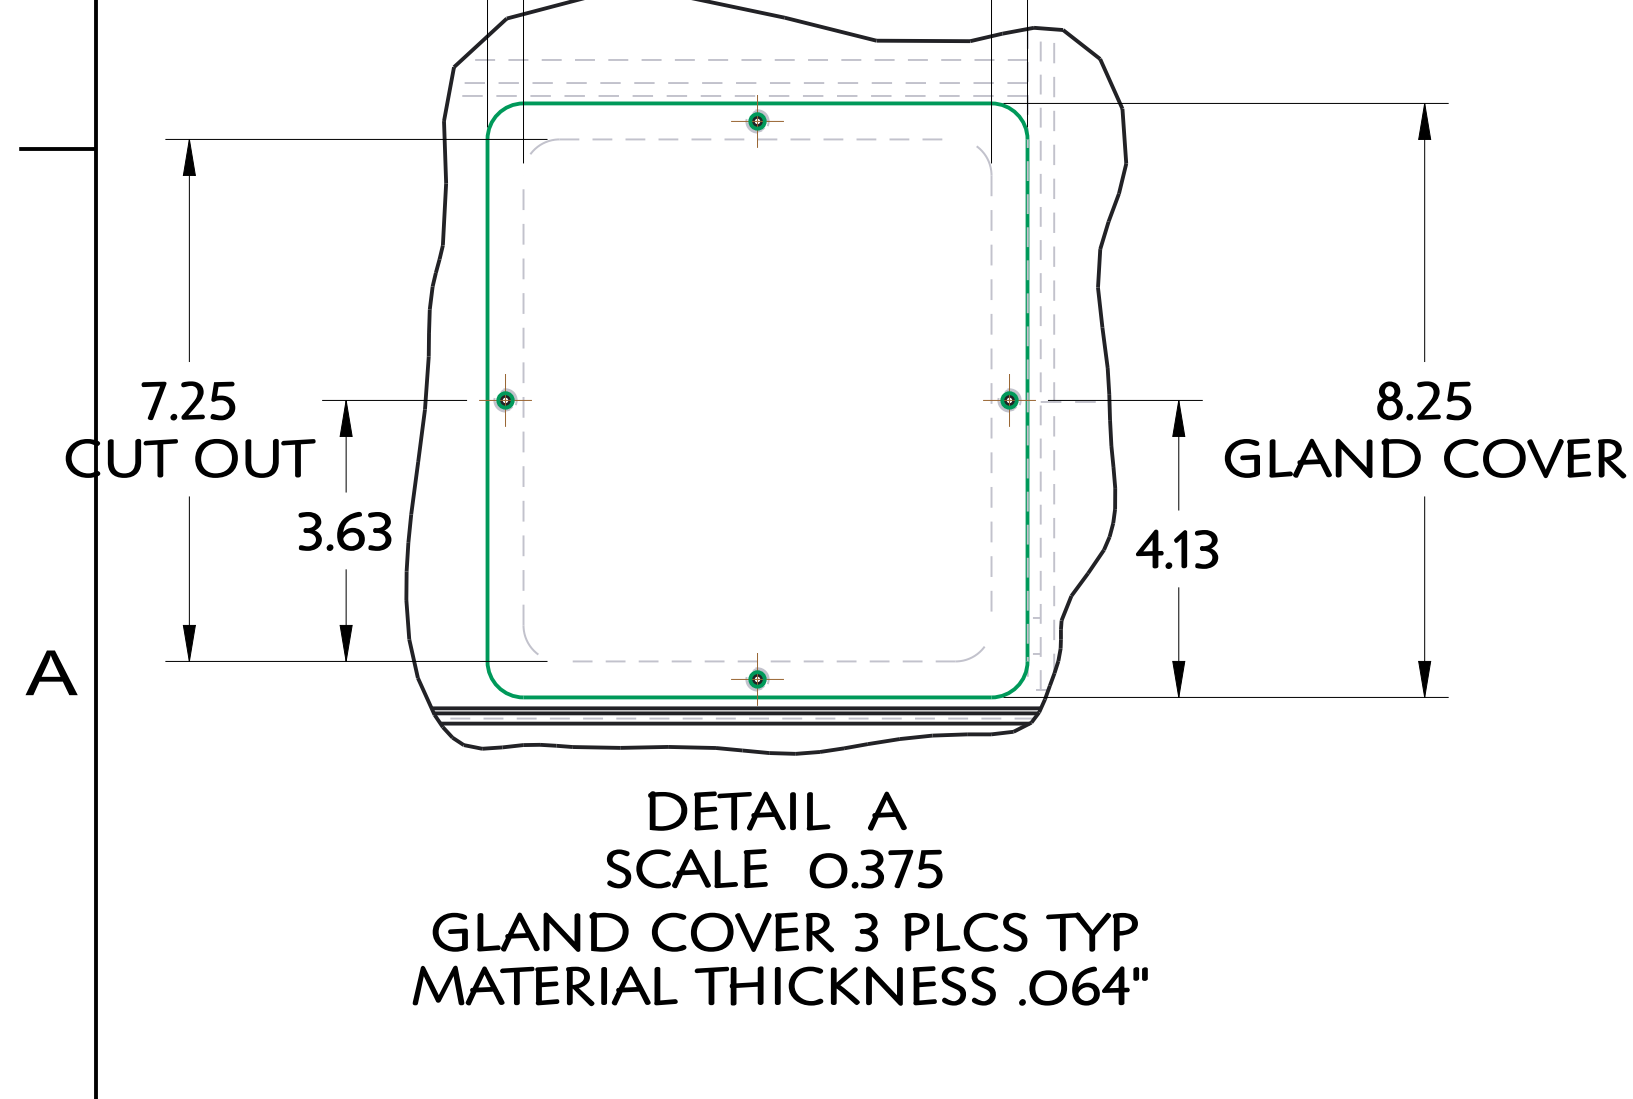

DO NOT DISTRIBUTE
 PROPRIETARY PROPERTY OF PRINCETON POWER SYSTEMS
 THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF PRINCETON POWER SYSTEMS INC. AND ITS RECEIPT OR POSSESSION DOES NOT CONVEY ANY LICENSE OR RIGHTS TO COPY OR REPRODUCE IT OR DISCLOSE ITS CONTENTS OR TO MANUFACTURE, USE OR SELL ANYTHING IT MAY DESCRIBE, WITHOUT THE WRITTEN APPROVAL OF PRINCETON POWER SYSTEMS. REPRODUCTION OR COPIING, DISSEMINATION, OR USE OF THIS DOCUMENT OR ANY OF ITS CONTENTS WITHOUT THE EXPRESS WRITTEN AUTHORIZATION OF PRINCETON POWER SYSTEMS IS STRICTLY PROHIBITED.

APPROVALS	INITIAL	DATE	 3175 Princeton Pike Lawrenceville, NJ 08648 www.princetonpower.com (609) 955-5390 (609) 751-9225
PREPARED BY	TRL	12/18/12	
REVIEWED BY	PH	12/18/12	
APPROVED BY	MH	12/18/12	
UNLESS OTHERWISE SPECIFIED TOLERANCES: MACHINED PARTS: FRACTIONS ± 1/32 DECIMALS: X.X ± 0.050 X.XX ± 0.015 X.XXX ± 0.005 ANGLES ± 1° SHEET METAL PARTS: HOLE TO HOLE: ± 0.010 EDGE TO HOLE: ± 0.010 HOLE TO BEND: ± 0.015 BEND TO BEND: ± 0.020 EDGE TO BEND: ± 0.020			DESCRIPTION PAD MOUNTING INSTALLATION DIAGRAM 250 kW BIGI - BATTERY INTEGRATED GRID INTERACTIVE SIZE D DWG# 2575-0019
SCALE 0.250	FILE# SEGIS_PHASE_III_FINAL_ASSY	SHEET 1 OF 1	1.0